

Konferenzbeiträge / Atti / Proceedings

Building Simulation Applications BSA 2022

5th IBPSA-Italy Conference
Bozen-Bolzano, 29th June – 1st July 2022

Edited by

**Giovanni Pernigotto, Francesco Patuzzi,
Alessandro Prada, Vincenzo Corrado, Andrea Gasparella**

bu,press

bozen
bolzano
university
press

unibz
—
Freie Universität Bozen
Libera Università di Bolzano
—
Università Lìdia de Bulsan

Konferenzbeiträge / Atti / Proceedings

Building Simulation Applications BSA 2022

5th IBPSA-Italy Conference
Bozen-Bolzano, 29th June –1st July 2022

Edited by

**Giovanni Pernigotto, Francesco Patuzzi,
Alessandro Prada, Vincenzo Corrado, Andrea Gasparella**

bu,press

bozen
bolzano
university
press

Scientific Committee

Ian Beausoleil-Morrison, Carleton University, Canada
Jan L.M. Hensen, Technische Universiteit Eindhoven, The Netherlands
Gregor P. Henze, University of Colorado Boulder, USA
Ardeshir Mahdavi, Technische Universität Wien, Austria
Athanasios Tzempelikos, Purdue University, USA
Reinhard Radermacher, University of Maryland, USA
Francesco Asdrubali, Università degli Studi Roma Tre, Italy
Paolo Baggio, Università degli Studi di Trento, Italy
Francesca Cappelletti, Università IUAV di Venezia, Italy
Maurizio Cellura, Università degli Studi di Palermo, Italy
Cristina Cornaro, Università degli Studi di Tor Vergata, Italy
Vincenzo Corrado, Politecnico di Torino, Italy
Andrea Gasparella, Free University of Bozen-Bolzano, Italy
Livio Mazzarella, Politecnico di Milano, Italy
Adolfo Palombo, Università degli Studi di Napoli Federico II, Italy

Students Tutoring Scientific Committee

Matthias Schuss, Technische Universität Wien, Austria
Ulrich Pont, Technische Universität Wien, Austria
Alessia Arteconi, Università Politecnica delle Marche, Italy
Ilaria Ballarini, Politecnico di Torino, Italy
Annamaria Buonomano, Università degli Studi di Napoli Federico II, Italy
Marco Caniato, Free University of Bozen-Bolzano, Italy
Gianpiero Evola, Università degli Studi di Catania, Italy
Federica Morandi, Free University of Bozen-Bolzano, Italy
Francesco Patuzzi, Free University of Bozen-Bolzano, Italy
Giovanni Pernigotto, Free University of Bozen-Bolzano, Italy
Anna Laura Pisello, Università degli Studi di Perugia, Italy
Alessandro Prada, Università degli Studi di Trento, Italy

Organizing Committee

Paolo Baggio, Università degli Studi di Trento, Italy
Marco Baratieri, Free University of Bozen-Bolzano, Italy
Marco Caniato, Free University of Bozen-Bolzano, Italy
Francesca Cappelletti, Università IUAV di Venezia, Italy
Vincenzo Corrado, Politecnico di Torino, Italy
Andrea Gasparella, Free University of Bozen-Bolzano, Italy
Norbert Klammsteiner, Energytech G.m.b.H./S.r.l -Bozen, Italy
Federica Morandi, Free University of Bozen-Bolzano, Italy
Francesco Patuzzi, Free University of Bozen-Bolzano, Italy
Giovanni Pernigotto, Free University of Bozen-Bolzano, Italy
Alessandro Prada, Università degli Studi di Trento, Italy
Fabio Viero, Manens – Tifs, Italy

bu,press

Bozen-Bolzano University Press, 2022

Free University of Bozen-Bolzano

www.unibz.it/universitypress

Cover design: DOC.bz / bu,press

ISSN 2531-6702

ISBN 978-88-6046-191-9

DOI 10.13124/9788860461919



This work—excluding the cover and the quotations—is licensed under the Creative Commons Attribution-ShareAlike 4.0 International License.

Table of Contents

| | |
|---|-----|
| Preface | ix |
| Optimization of Daylighting and Energy Performance in Bangladesh Ready-Made Garment Factories: Use of Parametric Design, Simulation Modeling, and Genetic Algorithms <i>Md Ashikur Rahman Joarder, Md Monir Hossain, Aaron J.E. Bach, Jean P. Palutikof, Fahim Tonmoy</i> | 1 |
| Transient Three-Dimensional CFD Modelling of Ceiling Fans: A Comparison Between Detailed and Simplified Models <i>Francesco Babich, Akshit Gupta, Wilmer Pasut</i> | 9 |
| Intelligibility Prediction in Scholar Classrooms <i>Samantha Di Loreto, Fabio Serpilli, Valter Lori, Costanzo Di Perna</i> | 17 |
| Hybrid Heat Pump Systems: Is Predictive Control Worth Using? <i>Patricia Ercoli, Alice Mugnini, Fabio Polonara, Alessia Arteconi</i> | 25 |
| The Acoustic Adaptation of the Aula Magna at the University of Bologna: Auditorium and Conference Hall Scenarios Simulated in the Main Nave of Santa Lucia's Church <i>Antonella Bevilacqua, Ruoran Yan, Maria Cristina Tommasino</i> | 33 |
| Implementation and Calibration of a Model to Treat Naturally Ventilated Complex Fenestration Systems in TRNSYS <i>Ingrid Demanega, Giovanni Gennaro, Giuseppe De Michele, Francesco Isaia, Fabio Favoino, Stefano Avesani</i> | 41 |
| Heat and Mass Transfer Modelling for Moisture-Related Risks in Walls Retrofitted by Timber Materials <i>Gianpiero Evola, Alessandra Urso, Vincenzo Costanzo, Francesco Nocera, Luigi Marletta</i> | 49 |
| Multi-Objective Optimization Of Thermo-Acoustic Comfort Of School Buildings <i>Daniele Colarossi, Samantha Di Loreto, Eleonora Tagliolini, Paolo Principi, Fabio Serpilli</i> | 67 |
| A Review on the FIVA-Project: Simulation-Assisted Development of Highly-Insulating Vacuum Glass Windows <i>Ulrich Pont, Peter Schober, Magdalena Wölzl, Matthias Schuss, Jakob Haberl</i> | 69 |
| Influence of Sound-Absorbing Ceiling on the Reverberation Time. Comparison Between Software and Calculation Method EN 12354-6 <i>Nicola Granzotto, Paolo Ruggeri, Fabio Peron, Marco Caniato, Andrea Gasparella</i> | 77 |
| Simulation of Thermal and Acoustic Façade Insulation Starting From the Characteristics of the Individual Elements <i>Nicola Granzotto, Paolo Ruggeri, Fabio Peron, Marco Caniato, Andrea Gasparella</i> | 85 |
| Climate Change Impact on Historical Buildings: A Case Study Within the Interreg Ita-Slo Secap Project <i>Marco Manzan, Amedeo Pezzi</i> | 95 |
| Hourly Dynamic Calculation of the Primary Energy With Heat Pump Generation System (EN 15316-4-2): A Case Study in Italy <i>Giada Remia, Serena Summa, Luca Tarabelli, Costanzo Di Perna</i> | 103 |
| A Project Focused on Sound Diffusion: The Acoustics of the Auditorium Yves St Laurent of Marrakech in Combination With its Innovative Architectural Design <i>Lamberto Tronchin, Antonella Bevilacqua, Ruoran Yan</i> | 111 |
| On the Prints of Another Horseshoe-Shaped Historical Building: Acoustic Studies of the Bonci Theatre of Cesena <i>Antonella Bevilacqua, Ruoran Yan</i> | 117 |
| Acoustic Discoveries of Another Masterpiece by Antonio Galli Bibiena: The Communal Theatre of Bologna <i>Antonella Bevilacqua, Ruoran Yan</i> | 123 |
| In Situ Measurement of Wall Thermal Properties: Parametric Investigation of the Heat Flow Methods Through Virtual Experiments Data <i>Andrea Alongi, Luca Sala, Adriana Angelotti, Livio Mazzarella</i> | 129 |

| | |
|---|-----|
| Investigating the Performance of Different Window Opening Styles for Single-Sided Wind-Driven Natural Ventilation Using CFD Simulations <i>Akshit Gupta, Annamaria Belleri, Francesco Babich</i> | 137 |
| The Management of the Energy Performance Simulation of a Complex Building Portfolio. The Case of the School Building Asset of an Italian Municipality <i>Claudia Bo, Enrico De Angelis, Andrea Augello</i> | 145 |
| Hourly-Simplified Calculation to Identify Cost-Optimal Energy Performance Requirements for the Italian Building Stock <i>Matteo Piro, Franz Bianco Mauthe Degerfeld, Giovanna De Luca, Ilaria Ballarini, Vincenzo Corrado</i> | 153 |
| A Novel Methodology for Risk Assessment of Airborne Transmission due to Covid-19 in University Classrooms <i>Giulia Lamberti, Roberto Rugani, Fabio Fantozzi</i> | 161 |
| Integrated Approach to Assess the Energy and Environmental Payback Time of Buildings Refurbishment: A Case Study <i>Marta Roncone, Francesco Asdrubali, Gianluca Grazieschi, Chiara Tonelli</i> | 169 |
| Comparison Between Measured and Calculated Values in Relation to Noise From Wind Turbines <i>Antonella Bevilacqua, Gino Iannace, Ilaria Lombardi, Amelia Trematerra</i> | 177 |
| Thermo-Hygrometric Comfort Analysis in a Real Public Conference Room to Support a Digital-Twin Targeted to Parametric Investigations <i>Roberto Bruno, Piero Bevilacqua, Daniela Cirone, Natale Arcuri</i> | 185 |
| Validation of Energy Simulations of a Sustainable Wooden House in a Mediterranean Climate <i>Piero Bevilacqua, Roberto Bruno, Daniela Cirone, Stefania Perrella, Natalia Shushunova, Natale Arcuri</i> | 193 |
| Thermal and Acoustic Simulation of a Technical Enclosure for High Voltage Control Equipment <i>Edoardo A. Piana, Somayan Basu, Francesco Palone, Simone Sacco, Roberto Spezie</i> | 199 |
| Investigating the Role of Humidity on Indoor Wellness in Vernacular and Conventional Building Typologies <i>Suchi Priyadarshani, Roshan R Rao, Monto Mani, Daniel Maskell</i> | 207 |
| An Investigation Into Thermal Performance of Buildings Built Using Upcycled End-Of-Life Photovoltaic Panels <i>Roshan R Rao, Suchi Priyadarshani, Monto Mani</i> | 217 |
| Determining the Energy Benefits from Passive Solar Design Integration through the Sensitivity Analysis of Different Case Studies <i>Giacomo Cillari, Alessandro Franco, Fabio Fantozzi</i> | 225 |
| A Novel Personal Comfort System: A Radiant Desk With a Loop Heat Pipe <i>Roberto Rugani, Marco Bernagozzi, Marco Picco, Giacomo Salvadori, Fabio Fantozzi</i> | 233 |
| Energy Signature Modeling Towards Digital Twins – Lessons Learned From a Case Study With TRV and GAHP Technologies <i>Massimiliano Manfren, Maria Cristina Tommasino, Lamberto Tronchin</i> | 243 |
| The Amintore Galli Theatre in Rimini: A Dataset of Building Simulation Tools for its Acoustic Design <i>Antonella Bevilacqua, Massimiliano Manfren, Maria Cristina Tommasino, Ruoran Yan, Lamberto Tronchin</i> | 249 |
| Data-Driven Building Energy Modelling – Generalisation Potential of Energy Signatures Through Interpretable Machine Learning <i>Massimiliano Manfren, Maria Cristina Tommasino, Lamberto Tronchin</i> | 255 |
| Estimated Versus Actual Heating Energy Use of Residential Buildings <i>Matthias Schuss, Martin Fleischhacker, Ardeshir Mahdavi</i> | 265 |
| Polyamide Waste Thermal and Acoustic Properties: Experimental and Numerical Investigation on Possible Reuse for Indoor Comfort Improvement <i>Manuela Neri, Eva Cuerva, Alfredo Zabaleta, Pablo Pujadas, Elisa Levi, Ondrej Sikula</i> | 273 |
| Assessment of Demand-Side Management on the Performance of a Single-Dwelling Mechanical Ventilation Plus Radiant Floor System <i>Paolo Bonato, Anton Soppelsa, Marta Avantaggiato, Roberto Fedrizzi</i> | 281 |
| Passive Design Strategies for the Improvement of Summer Indoor Comfort Conditions in Lightweight Steel-Framed Buildings <i>Nicola Callegaro, Max Wieser, Giovanni Manzini, Ivan Kharlamov, Rossano Albatici</i> | 289 |
| Energetic Optimisation of the Domestic Hot Water System in a Residential Building by Means of Dynamic Simulations <i>Paolo Valdiserri, Aminhossein Jahanbin, Giovanni Semprini</i> | 299 |

| | |
|--|-----|
| Assessing the Climate Resilience of Passive Cooling Solutions for Italian Residential Buildings <i>Mamak P. Tootkaboni, Ilaria Ballarini, Vincenzo Corrado</i> | 305 |
| Ventilation of Residential Buildings in Alpine Region: A Comparison Between Natural, Mechanical, and Mixed-Mode Strategies <i>Francesca Avella, Paolo Bonato, Annamaria Belleri, Francesco Babich</i> | 313 |
| A Comparison Among Three Whole-Building Dynamic Simulation Software and their Applicability to the Indoor Climate Modelling of Historical Buildings <i>Francesca Frasca, Elena Verticchio, Michele Libralato, Paola D'Agaro, Giovanni Cortella, Anna Maria Siani, Cristina Cornaro</i> | 321 |
| QGIS-Based Tools to Evaluate Air Flow Rate by Natural Ventilation in Buildings at Urban Scale <i>Silvia Santantonio, Guglielmina Mutani</i> | 331 |
| Modeling Energy Consumption in a Single-Family House in South Tyrol: Comparison Between Hemp Concrete and Clay Bricks <i>Silvia Ricciuti, Irene Lara-Ibeas, Annamaria Belleri, Francesco Babich</i> | 341 |
| A Fully Automated and Scalable Approach for Indoor Temperature Forecasting in Buildings Using Artificial Neural Networks <i>Jakob Bjørnskov, Muhyiddine Jradi, Christian Veje</i> | 349 |
| Effects of Different Moisture Sorption Curves on Hygrothermal Simulations of Timber Buildings <i>Michele Libralato, Maja Danovska, Giovanni Pernigotto, Andrea Gasparella, Paolo Baggio, Paola D'Agaro, Giovanni Cortella</i> | 357 |
| Energy Performance Evaluation and Economical Analysis by Means of Simulation Activities for a Renovated Building Reaching Different Nzeb Definitions Targets <i>Riccardo Gazzin, Jennifer Adami, Mattia Dallapiccola, Davide Brandolini, Miren Juaristi Gutierrez, Diego Tamburrini, Paolo Bonato, Martino Gubert, Stefano Avesani</i> | 367 |
| Preliminary CFD Parametric Simulations of Low- and Medium-Density Urban Layouts <i>Ritesh Wankhade, Giovanni Pernigotto, Michele Larcher</i> | 377 |
| Smart Sensors and Auditory Sensitivity: Acoustic Optimization of Dedicated Spaces for Autistic Individuals <i>Federica Bettarello, Marco Caniato, Arianna Marzi, Giuseppina Scavuzzo, Andrea Gasparella</i> | 387 |
| Simulation Application for the Assessment of the Energy Performance of a Building Renovated Using I-BEST System (Innovative Building Envelope through Smart Technology) <i>Cristina Carpino, Mario Maiolo, Patrizia Piro, Roberto Bruno, Natale Arcuri</i> | 395 |
| Modeling Occupants' Behavior to Improve the Building Performance Simulation of Classrooms <i>Federica Morandi, Julian Donges, Ilaria Pittana, Alessandro Prada, Francesca Cappelletti, Andrea Gasparella</i> | 403 |
| Modeling and Measurements in Natural Ventilation of Massive Buildings: A Case Study <i>Francesco Asdrubali, Luca Evangelisti, Claudia Guattari, Marta Roncone, Lucia Fontana, Ginevra Salerno, Chiara Tonelli, Valeria Vitale</i> | 411 |
| Calibration of the Energy Simulation Model of a Library with a Meta-Model-Based Optimization Approach <i>Maja Danovska, Alessandro Prada, Paolo Baggio</i> | 417 |
| Development of a Detailed Model of Hybrid System Composed by Air-to-Water Heat Pump and Boiler <i>Erica Roccatello, Alessandro Prada, Marco Baratieri, Paolo Baggio</i> | 427 |
| The Role of Ventilation in Indoor Spaces During the Covid-19 Pandemic: Comprehensive Analysis of ASHRAE Standard 62.1 <i>Giovanni Francesco Giuzio, Giovanni Barone, Annamaria Buonomano, Gianluca Del Papa, Cesare Forzano, Adolfo Palombo, Giuseppe Russo</i> | 437 |
| Design of Energy-Neutral Smart Buildings: An Ontological Framework to Integrate LCA, BIM and PLM <i>Tarun Kumar, Monto Mani</i> | 449 |
| Assessing the Performance of a Simplification Algorithm for Urban Building Energy Modeling in Multi-Objective Optimization <i>Federico Battini, Giovanni Pernigotto, Andrea Gasparella</i> | 457 |
| Application of a Simplification Algorithm for Urban Building Energy Modeling to Complex-Shaped Educational Buildings <i>Matteo Merli, Federico Battini, Giovanni Pernigotto, Andrea Gasparella</i> | 465 |
| Numerical Investigation of Radiation Efficiency of a Cross-Laminated Timber Floor <i>Marco Caniato, Nicola Granzotto, Federica Bettarello, Arianna Marzi, Paolo Bonfiglio, Andrea Gasparella</i> | 473 |

| | |
|---|-----|
| Assessment of Contagion Risk due to Covid-19 for a Multi-Zone Building Model of Offices <i>Riccardo Albertin, Alessandro Pernici, Giovanni Pernigotto, Andrea Gasparella</i> | 479 |
| Impact of Visual, Thermal, and Indoor Air Quality Conditions on Students' Wellbeing and Learning Performance in a Primary School of Bolzano, Italy <i>Giovanni Demozzi, Luca Zaniboni, Giovanni Pernigotto, Andrea Gasparella</i> | 489 |
| Performance Simulation of Desiccant Wheel under Dynamic Conditions: <i>Comparison between Detailed and Simplified Models</i> <i>Simone Dugaria, Andrea Gasparella</i> | 499 |
| BIM and Mixed Reality for Visualizing Building Energy Data <i>Dietmar Siegele, Paola Penna, Ilaria Di Blasio, Michael Riedl</i> | 507 |
| Impact of Solar Radiation Modelling on the Simulated Building Energy Performance in the Climate of Bolzano, Italy <i>Giovanni Pernigotto, Alessandro Prada, Aleksandr Gevorgian, Andrea Gasparella</i> | 515 |
| Effect of the Time Interval Base on the Calculation of the Renewable Quota of Building in an Alpine Context <i>Margherita Povolato, Alessandro Prada, Paolo Baggio</i> | 525 |
| Innovative Approaches for Teaching BPS: First Implementations of Business Game-Like Activities <i>Andrea Gasparella</i> | 533 |

Passive Design Strategies for the Improvement of Summer Indoor Comfort Conditions in Lightweight Steel-Framed Buildings

Nicola Callegaro – University of Trento, Italy – nicola.callegaro@unitn.it

Max Wieser – University of Trento, Italy – max.wieser@unitn.it

Giovanni Manzini – Cogi S.r.l., Italy – lorenzo.manzini@cogi.info

Ivan Kharlamov – Altai State University, Russia – kharlamov-1948@mail.ru

Rossano Albatici – University of Trento, Italy – rossano.albatici@unitn.it

Abstract

The market for lightweight construction systems is growing rapidly due to their potential in terms of prefabrication, ease of transportation and assembly. However, given their thermophysical properties, these types of structures present a limited thermal capacity that may reduce their performance in terms of comfort and energy consumption during the hot seasons. The present paper, through a series of computational fluid dynamics (CFD) simulations, offers a numerical assessment of the performance of an existing lightweight steel-framed building selected as a case study. The data required to perform the simulations are collected with a deep monitoring campaign and the building is analysed in its current state (actual conditions of use) and after the application of simulated passive cooling strategies. The role of natural ventilation, both day and night, is explored by investigating different opening/closing configurations of external windows and internal doors. Moreover, the positive effects of surface thermal mass and shading systems are numerically validated. The results, although limited to a specific context of analysis, show that, with appropriate adaptation strategies, even in lightweight buildings, occupants can achieve adequate levels of comfort, thus reducing the need for cooling. A combined and weighted use of passive solutions results in a reduction of about 3 °C in the average daily indoor temperature. Ventilation at night and solar shading during the day make a steel-framed building as comfortable as a massive one, both with regard to the internal surface temperature of the building components and to the discomfort indices. Changing the mass of the interior cladding of a wall, ceiling or floor, for example, from plasterboard to cement board, is another effective cooling strategy.

1. Introduction

Reducing costs, increasing speed, and minimizing risks have always been the main objectives of the construction industry. Buildings are therefore increasingly made up of standardized and performance-guaranteed components, both considering the systems and the envelope. The market for lightweight steel-framed building systems (LSF) has thus greatly increased over the last few decades, especially in low-rise residential buildings. Several advantages have driven their spread: ease and speed of on-site installation, low weight combined with high mechanical strength, large potential for recycling and reuse, easy prefabrication, flexibility of use for different architectural retrofit purposes, economy in transportation and handling, resistance to moisture and insect attack (Soares et al., 2017).

However, lightweight structures, particularly steel-framed ones, can contribute towards reducing building energy and indoor comfort performance during hot seasons (Lomas & Porritt, 2016) due to steel's high thermal conductivity and lightness (Santos, 2017). This represents a significant challenge, since with the increase in average annual temperature and the continuous growth of electricity demand, particularly of the residential sector, summer air conditioning has had a very significant influence on the overall energy consumption of buildings (Santamouris, 2016).

However, the use of additional thermal mass and high values of internal areal heat capacity can minimize peak heating and cooling loads in lightweight buildings (Di Perna et al., 2011; Kuczyński & Staszczuk, 2020; Rodrigues et al., 2013), especial-

ly when coupled with natural or mechanical ventilation (Yang & Li, 2008). CFD simulation is considered the most valuable tool for designing, verifying, and predicting the indoor thermal comfort level in relation to these aspects. Through this type of simulation, Mora-Pérez et al. (2017) explain the benefits of combined use of mechanical and natural ventilation to maximize comfort and reduce energy consumption. Much attention is often paid to the influence of the specific building component. Deng et al. (2017) discuss in depth the impact of window length, aspect ratio, height above the ground, window opening angle and fly screen porosity on the airflow pattern inside residential buildings. Aryal and Leephakpreeda (2015) emphasize how interior partitions significantly change perceived thermal comfort and the resulting energy consumption for heating and cooling, while Hajdukiewicz et al. (2013) focus on highly-glazed façades in meeting rooms. Few articles simultaneously address different cooling passive strategies through CFD simulation, and the study of lightweight structures, such as steel-framed, is still limited in this field.

In this paper we investigate the effectiveness of lightweight steel-framed structures to ensure, through the implementation of passive design and use strategies, high levels of indoor comfort during the hot season. Through CFD simulation, the paper explores the ways in which natural ventilation, wall heat capacity and external shadings can reduce indoor temperatures and improve comfort. Different windows and door opening/closing patterns are compared at (a) different external wind speeds and (b) the ability of windows shadings to mitigate temperature peaks is evaluated. The behavior of (c) different wall surface claddings with changed weight is also investigated and, finally, a comparison (d) is made between the starting lightweight structure (steel-frame with external insulation), the same structure with the implementation of the aforementioned passive strategies, an insulated reinforced concrete massive structure and an insulated brick structure. Simulations are performed on a case study built in 2018 in Barnaul (RU), southwestern Siberia, and monitored for two years. The continental climate of the area has a high seasonal temperature range with lows of $-35\text{ }^{\circ}\text{C}$ in winter and highs of $+35\text{ }^{\circ}\text{C}$ in the hot sea-

son. The summer behavior of the building was examined, taking into account these particular extreme environmental conditions which, however, due to climate change, will also be increasingly common in less severe climates (IPCC, 2021).

2. Materials and Methods

In this section, the case study, methodology and simulation tools, as well as the parameters monitored, are presented. In addition, the characteristics and the boundary conditions of the simulation model, the different passive strategies implemented, and the output variables analysed in Section 3 are described in depth.

2.1 The Case Study

The case study is a single-storey residential building realized, as regards the structural design, with panels made of cold-bent steel profiles (Fig. 1a-1b). The building is about 80 square meters and is divided into entrance, living room-kitchen, bathroom, boiler room and two bedrooms (Fig. 2). An insulated ceiling divides the living space from the pitched roof, made of sandwich panels. The heating system is powered by gas condensation boiler, and a controlled mechanical ventilation ensures the indoor-outdoor air exchange.



Fig. 1 – The building during (a) and at the end of the construction phase (b). Picture by Giovanni Manzini, 2019

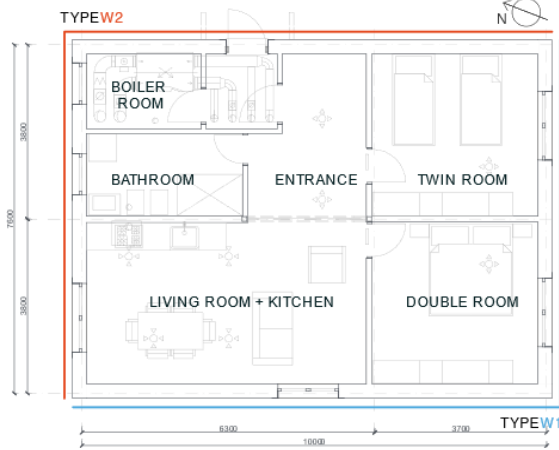


Fig. 2 – Horizontal section of the building

Table 1 – Thermophysical properties of the wall W1

| Layers (int. to ext.) | s [cm] | λ [W/(m K)] | ρ [kg/m ³] | c [J/(kg K)] |
|--|-----------|------------------------|--------------------------------|-----------------|
| Plasterboard | 2.5 | 0.2 | 800 | 836.8 |
| Insulated Counter-Wall | 7 | 0.072 | 101.24 | 1024.3 |
| Glass wool | 8 | 0.035 | 35 | 1030 |
| Plasterboard | 1.25 | 0.2 | 800 | 836.8 |
| SteelMAX® Structure + insulation | 10 | 0.067 | 143.78 | 1022.6 |
| Cement board | 1.25 | 0.35 | 1150 | 836.8 |

Table 2 – Thermophysical properties of the wall W2

| Layers (int. to ext.) | s [cm] | λ [W/(m K)] | ρ [kg/m ³] | c [J/(kg K)] |
|--|-----------|------------------------|--------------------------------|-----------------|
| Plasterboard | 2.5 | 0.2 | 800 | 836.8 |
| Insulated Counter- Wall | 5 | 0.068 | 101.2 | 1024.2 |
| Glass wool | 5 | 0.035 | 35 | 1030 |
| Plasterboard | 1.25 | 0.2 | 800 | 836.8 |
| SteelMAX® Structure + insulation | 10 | 0.067 | 143.78 | 1022.6 |
| Cement board | 1.25 | 0.35 | 1150 | 836.8 |
| EPS insulation | 5 | 0.038 | 21 | 1260 |

The building has two different external walls (Tables 1-2, Fig. 2) to test in-situ, through monitoring data, the energy performance of two akin solutions. Table 3 describes the thermal properties of the main building components.

The building is equipped with energy and environmental sensors to monitor its behavior 24 hours a day. The monitored parameters are:

- temperature, relative humidity, and CO₂ of all indoor environments.
- surface and internal temperatures of walls, ceiling, floor.
- inlet and outlet temperature of the controlled mechanical ventilation machine.
- energy consumption.
- external environmental conditions (temperature, humidity, wind speed and direction, solar radiation).

The data monitored provided the necessary information to set the boundary conditions for the simulation model.

2.2 The Simulation Model

Computational fluid dynamics (CFD) is a branch of fluid mechanics that analyses and solves problems involving fluid flows using numerical analysis and data structures (Lomax et al., 2013). CFD analysis involves the simultaneous calculation of temperature and velocity domains, flows and pressures, considering the interaction between these variables. The great advantage of this type of simulation, compared to simplified empirical formulae, is the three-dimensional representation of the results. Properly setting the calculation grid and cell size, which have a significant impact on the calculation time and memory demands, as well as on the accuracy of the results, is a key prerequisite for the robustness of the CFD simulation. The minimum size of the cells is determined according to the specific problem to be analysed: for this case study, the volume of a single calculation cell is 8 cm³ (2x2x2 cm). The number of cells also depends on the calculation domain. In order to include the effect of wind, which is essential for assessing the benefits of natural ventilation, a larger calculation domain than the building envelope is required, which may lead to a higher calculation effort.

Table 3 – Thermal properties of the building components

| | W1 Walls | W2 Walls | Ceiling | Ground floor |
|---|-------------|-------------|---------|-----------------|
| Thickness [cm] | 30 | 30 | 43 | 45 |
| Thermal transmittance [W/m ² K] | 0.194 | 0.186 | 0.27 | 0.31 |
| Decrement factor [-] | 0.59 | 0.32 | 0.07 | - |
| Time lag [h] | 6.68 | 8.8 | 14.2 | - |
| Internal areal heat capacity [kJ/m ² K] | 22.4 | 20.9 | 38.2 | - |
| Periodic thermal transmittance [W/m ² K] | 0.114 | 0.06 | 0.019 | - |

The domain must be large enough not to bias the result and is typically expressed as a function of the building size. In accordance with Etheridge (2011), the following domains have been evaluated:

- Domain A: this coincides with the internal surface of the envelope. Boundary conditions at the inlets and outlets must be specified to run the simulation
- Domain B: external domain. The supply flow rate is determined as part of the simulation for this type of domain, which has dimensions that are normally twice those of the envelope. This means that the boundary conditions are different, and problems of convergence can arise.
- Domain C: the external flow to the inlet is included in the calculation. This requires extending the domain by an order of magnitude larger than the envelope.
- Domain D (used in the calculation): CFD boundary conditions for internal flows are generated using CFD data for the external flow.

Domain type D used in the case study simulation is a volume of 260 m³ (10.3x7.8x3.25 m) with boundaries that coincide with the internal walls. Based on a calculation previously carried out with an enlarged domain (type C: size of the domain is five times the size of the building), CFD allows wind velocity and air pressure along the building surface

to be calculated. This choice reduces computational effort and, at the same time, enables the wind effects to be adequately considered. As regards the turbulence model for the calculation, the k-epsilon model was applied. The simulation model is built in Flovent®, proprietary software from Mentor Graphics®. For any other specifications regarding the methodology or the theory underlying the calculation, please refer to (Mentor Graphics Corporation, 2018).

2.3 Cooling Passive Strategies

2.3.1 Daytime natural ventilation

The transient simulation investigated the daily behavior of the building to the variation of the external climatic conditions, by focusing the analysis on the 48 hottest hours of the summer (3rd-4th of July). The set time step is 1 hour. Several monitor points were defined at different heights and in different rooms. The initial boundary conditions were set according to the data measured on site (Tab. 4). At first, an average wind velocity of 1.3 m/s in a north-westerly to south-easterly direction was considered, equal to the average wind speed measured in situ on that day. Then, extreme conditions of no wind and strong wind (0 and 5 m/s) were set to verify the reliability of the results and the magnitude of the wind.

Table 4 – Simulation boundary conditions

| | Min | Max | Mean |
|--|------|------|------|
| Hourly outdoor temperature [°C] (see also Fig. 7c) | 13.6 | 32.2 | 23.1 |
| Solar radiation [W/m ²] (at 12.30 PM) | | 873 | |
| Starting indoor temperature [°C] | | 25 | |

Several combinations are simulated (Tab. 5) with different window opening/closing schemes (Fig. 3). The daytime period is considered to start at 4 AM and end at 9 AM. In this case, it was considered that night ventilation was not feasible for other reasons (e.g., safety, noise, security).

Table 5 – Daytime natural ventilation: simulation cases

| Sim. | Int. doors | Awning Windows | Hopper Windows | Wind |
|------|------------|----------------|--------------------|---------|
| 0 | Closed | - | - | - |
| D10 | Closed | - | F1, F2, F4, F5, F6 | 1.3 m/s |
| D11 | Closed | - | F1, F2, F4, F5, F6 | 0 m/s |
| D12 | Closed | - | F1, F2, F4, F5, F6 | 5 m/s |
| D13 | Opened | - | F1, F2, F4, F5, F6 | 1.3 m/s |
| D14 | Opened | - | F1, F2, F4, F5, F6 | 0 m/s |
| D15 | Opened | - | F1, F2, F4, F5, F6 | 5 m/s |
| D20 | Closed | F1, F2, F4 | F5, F6 | 1.3 m/s |
| D21 | Closed | F1, F2, F4 | F5, F6 | 0 m/s |
| D22 | Closed | F1, F2, F4 | F5, F6 | 5 m/s |
| D23 | Opened | F1, F2, F4 | F5, F6 | 1.3 m/s |
| D24 | Opened | F1, F2, F4 | F5, F6 | 0 m/s |
| D25 | Opened | F1, F2, F4 | F5, F6 | 5 m/s |



Fig. 3 – Windows nomenclature (a). Awning window example (b); hopper window example (c).

<https://blog.jonnew.com/assets/windows/types.jpg>

For this and all simulations described in the next subsections, the output control variables are:

- Indoor temperature
- Internal wall surface temperature
- Predicted mean vote (PMV) (UNI, 2006)
- Predicted Percentage of Dissatisfied (PPD) (UNI, 2006)

Regarding PMV and PPD, to facilitate the calculation, some conditions were assumed to be constants:

- standing activity (1.2 met).
- summer clothing (0.5 clo).
- a relative humidity of 50 %.

The focus of the research was the thermal performance of the building. No acoustic and/or lighting comfort requirements were considered.

2.3.2 Nighttime cooling ventilation

The reduction of surface temperature of the walls, floor, and roof as a result of opening windows at night was explored by running a dynamic simulation. The role of various external window and internal door closing/opening techniques was examined. The night period is considered to start at 9 PM and end at 4 AM. The boundary conditions for temperature and solar radiation are the same as those shown in Table 4. The different combinations are listed in Table 6.

Table 6 – Nighttime cooling ventilation: simulation cases

| Sim. | Int. doors | Awning Windows | Hopper Windows | Wind |
|------|------------|----------------|--------------------|---------|
| 0 | Closed | - | - | - |
| N10 | Closed | - | F1, F2, F4, F5, F6 | 0.5 m/s |
| N11 | Closed | - | F1, F2, F4, F5, F6 | 0 m/s |
| N12 | Closed | - | F1, F2, F4, F5, F6 | 5 m/s |
| N13 | Opened | - | F1, F2, F4, F5, F6 | 0.5 m/s |
| N14 | Opened | - | F1, F2, F4, F5, F6 | 0 m/s |
| N15 | Opened | - | F1, F2, F4, F5, F6 | 5 m/s |
| N20 | Closed | F1, F2, F4 | F5, F6 | 0.5 m/s |
| N21 | Closed | F1, F2, F4 | F5, F6 | 0 m/s |
| N22 | Closed | F1, F2, F4 | F5, F6 | 5 m/s |
| N23 | Opened | F1, F2, F4 | F5, F6 | 0.5 m/s |
| N24 | Opened | F1, F2, F4 | F5, F6 | 0 m/s |
| N25 | Opened | F1, F2, F4 | F5, F6 | 5 m/s |

2.3.3 Influence of thermal mass

To evaluate the effect of the surface thermal mass (UNI, 2017), three different simulations were carried out by varying the internal finishing layer, from plasterboard to cement board to plaster (Table 7).

- Sim n° 0: original case study.
- Sim n° M1: the internal plasterboard is replaced by 2 panels of cement board.

- Sim n° M2: the internal plasterboard is replaced by 3 panels of cement board.
- Sim n° M3: the internal plasterboard is replaced by 2cm of plaster (the air layer in the ceiling is thus eliminated).

The reduction of the surface temperature of the walls, floor, and roof due to the material replacement was studied, as well as the comfort (PMV/PPD) and the reduction of the internal temperature peaks during the day. The dynamic analysis was carried out on two days with conditions similar to those shown in Table 4. The effects were evaluated on the second day of the analysis.

Table 7 – Thermal mass influence: simulation cases

| Internal areal heat capacity [kJ/(m²K)] | | | |
|---|-------------|-------------|---------|
| Sim. | North Walls | South Walls | Ceiling |
| 0 | 20.9 | 22.4 | 38.2 |
| M1 | 33 | 34.6 | 43.9 |
| M2 | 42.2 | 43.6 | 49.8 |
| M3 | 33.3 | 34.3 | 52.2 |

2.3.4 Final comparison

The best cases from the previous 3 analyses were combined to obtain a best practice (case a). This was compared with the original building (case b) and with the same building modifying the load-bearing structure from insulated steel-frame ($\lambda=0.58$ W/(m K), $\rho=100$ kg/m³) to reinforced concrete ($\lambda=1.4$ W/(m K), $\rho=2300$ kg/m³ - case c) to brick ($\lambda=0.35$ W/(m K), $\rho=700$ kg/m³ - case d). A further comparison was made by optimizing "case i" by adding windows external shading (case e). This was simulated by reducing the solar heat gain coefficient of window glass by 85 % when the windows are closed.

3. Results and Discussion

As regards natural daytime ventilation, with reference to the simulations from D10 to D15 shown in Table 5, the most cooled surfaces are the floor (massive element), followed by the leeward external walls, the internal partitions and, finally, the

windward walls and the roof (Fig. 4). The cooling rate is similar for the different configurations. In simulation D15 (strong wind and open internal doors), the greatest benefits are found in terms of reduction of indoor temperature and surface temperature (about 3 °C), but the indoor air velocities lead to unacceptable levels of discomfort. The considerations are similar for simulations D20 to D25 (awning windows). It is worth noting that the results are very dependent on the boundary conditions and are mainly useful for comparison. Simulations D10 and D20, which are, in Fig. 4, compared with the base case, reveal that a proper window opening strategy during the daytime, with appropriate outdoor environmental conditions, can reduce the daily average surface temperature of the building components by approximately 2 °C during a typical summer day.

In the case of nighttime natural ventilation combined with an accurate opening strategy for windows and internal doors, it is possible to reduce the temperature of the internal surfaces of the building by up to 7 °C (Fig. 5). Different natural ventilation strategies lead to different results. The analysis shows that cross ventilation, enabled by the opening of the inner doors, produces a 1 °C reduction in the internal temperature compared with single side ventilation. The combination of curtains and hopper windows (SimN23) is most effective in cooling the air volume near the floor area (Fig. 5), which could positively affect comfort conditions of a person lying at rest.

As regards the analysis performed by modifying the wall and roof cladding surfaces (Fig. 6), it can be stated that:

- in the M1 case study, with the replacement of plasterboard by cement board, the reduction of the average internal temperature is about 1°C during the daytime
- the 3 fibrocement panels(M2), which are, in any case, not easy to install from a technical point of view, so were considered only as a theoretical comparison, would guarantee a temperature reduction of 3 °C, with excellent benefits also in terms of PMV and PPD

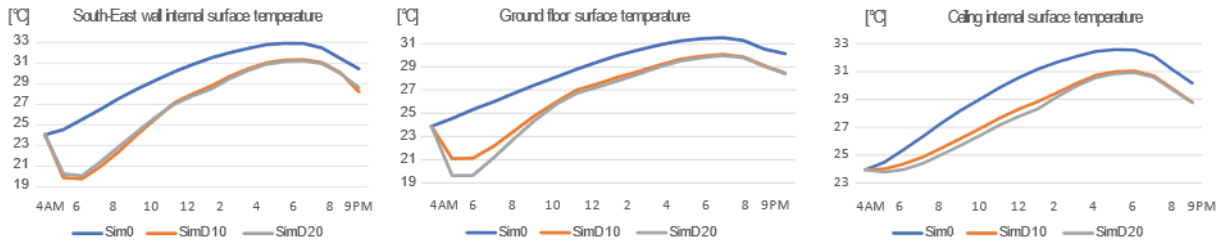


Fig. 4 – Daytime natural ventilation simulations results: internal surface temperatures of different building components (4th of July)

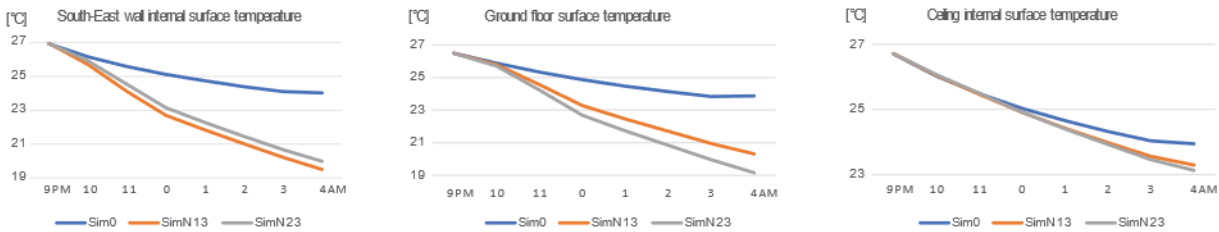


Fig. 5 – Nighttime natural ventilation simulations results: internal surface temperatures of different building components (4th of July)

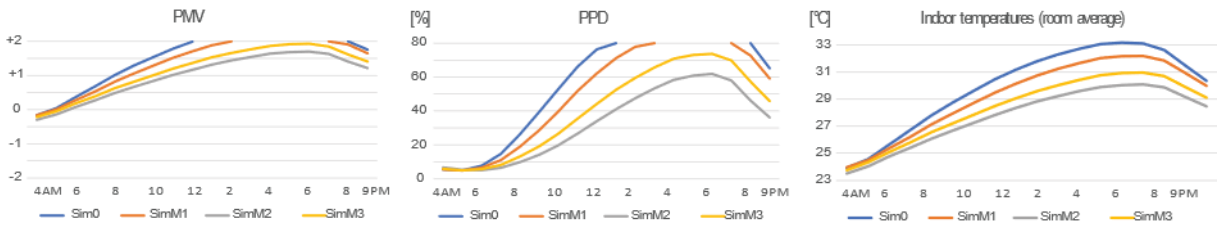


Fig. 6 – Thermal mass simulations results: PMV (a), PPD (b) and indoor temperature (c) trends (4th of July)

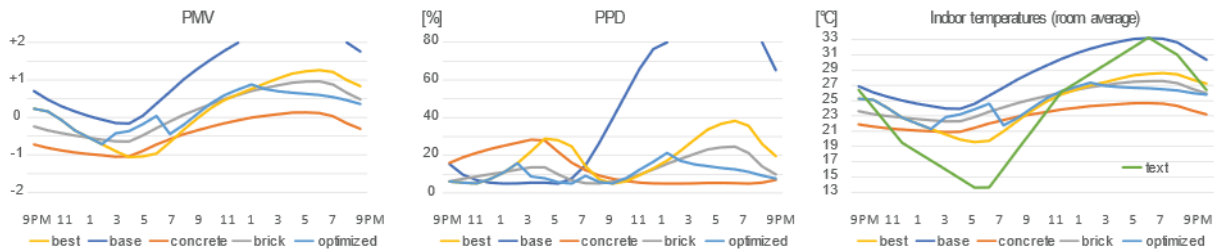


Fig. 7 – Final comparison results: PMV (a), PPD (b) and temperature (c) trends (3rd-4th of July)

- plaster would certainly be more efficient than plasterboard (M3), with a reduction of about 2.2 °C in the average internal temperature.

This positive effect also affects internal surface temperatures for all building components, thus increasing the indoor mean radiant temperature. Therefore, in the M2 case, the percentage reduction of PPD is over 20 %.

Fig. 7 compares data from the on-site monitoring system (base) with simulations described in Section 2.3.4. Massive/Solid constructions (concrete and brick) prove to be effective in softening outdoor temperature peaks, as noted in the literature. However, the combination of multiple passive cooling

strategies (best), including a well-planned window opening strategy and heavier interior surface cladding materials, can positively reduce the risk of overheating even in steel-framed constructions.

The "optimized" case, which simulates the presence of a shading system through the reduction of the window solar heat gain coefficient, demonstrates how it is possible to achieve a more-than-acceptable level of comfort in light structures even in summer. Please note that the plots in Fig. 7 represent a 24-hour zoom on a simulation conducted over multiple days. For this reason, the initial indoor temperature conditions do not reflect those described in Table 4.

2. Conclusion

This work, starting from the monitoring of a real case study, provides a numerical evaluation of the indoor thermal comfort achieved in residential buildings during summer by applying passive cooling strategies. The focus is on lightweight steel-framed buildings, where, as the literature has frequently highlighted, overheating is still a big issue. Different strategies were tested through CFD simulations: from natural day and night ventilation to the implementation of different interior surface finishing materials, from different window opening configurations to external shading systems.

Based on the achieved results the paper confirms that:

- it is possible to adjust the nighttime discomfort level (too cold or too hot temperatures) by natural ventilation. It is necessary to find a compromise between the need to cool the envelope components and the internal ambient temperature, which strongly depend on the strategy adopted and, more generally, on the external temperature, wind speed and direction. Acoustic and lighting comfort issues should also be considered.
- the most effective strategy to regulate the daytime discomfort level is to shade window surfaces.
- daytime ventilation, in the analyzed conditions, produce limited effects. It is highly influenced by outdoor environmental condition trends, solar radiation, and sun exposure.
- by simply replacing the internal surface layer, without modifying the load-bearing structure, the internal areal heat capacity of the walls can be increased with positive effects on thermal comfort.

In this paper, monitoring data were exclusively used to set the boundary conditions for the simulation model. In the future, the implemented monitoring system will make it feasible to compare simulation findings with on-site measurements, calibrate the model, and put the recommended strategies into practice, involving building users. Further analysis will be required to evaluate the achieved results at different times of the year and with other building types.

Acknowledgement

This work was realized within the IsolMAX project funded by Cogi Srl - Italy and supported by the Operative Program FESR 2014-2020 of the Autonomous Province of Trento. The authors would like to thank the architect Basilio Guerra of Enerconsult Srl – Brescia (Italy) for his valuable contribution towards the monitoring campaign, and to remember the surveyor Mario Guidotti, head of the project, who recently passed away.

References

- Aryal, P., and T. Leephakpreeda. 2015. "CFD Analysis on Thermal Comfort and Energy Consumption Effected by Partitions in Air-Conditioned Building." *Energy Procedia* 79: 183–188. doi: <https://doi.org/10.1016/J.EGYPRO.2015.11.459>
- Deng, X., P. Cooper, Z. Ma, and G. Kokogiannakis. 2017. "Numerical analysis of indoor thermal comfort in a cross-ventilated space with top-hung windows." *Energy Procedia* 121: 222–229. doi: <https://doi.org/10.1016/J.EGYPRO.2017.08.021>
- Di Perna, C., F. Stazi, A. U. Casalena, and M. D’Orazio. 2011. "Influence of the internal inertia of the building envelope on summertime comfort in buildings with high internal heat loads." *Energy and Buildings* 43(1): 200–206. doi: <https://doi.org/10.1016/J.ENBUILD.2010.09.007>
- Etheridge, D. 2011. *Natural Ventilation of Buildings: Theory, Measurement and Design*. Wiley.
- Hajdukiewicz, M., M. Geron, and M. M. Keane. 2013. "Calibrated CFD simulation to evaluate thermal comfort in a highly-glazed naturally ventilated room." *Building and Environment* 70: 73–89. doi: <https://doi.org/10.1016/J.BUILDENV.2013.08.020>
- IPCC. 2021. *Climate Change 2021: The Physical Science Basis. Contribution of Working Group I to the Sixth Assessment Report of the Intergovernmental Panel on Climate Change*. Cambridge University Press.

- Kuczyński, T., and A. Staszczuk. 2020. "Experimental study of the influence of thermal mass on thermal comfort and cooling energy demand in residential buildings." *Energy* 195: 116984. doi: <https://doi.org/10.1016/J.ENERGY.2020.116984>
- Lomas, K. J., and S. M. Porritt. 2016. "Overheating in buildings: lessons from research." *Building Research & Information* 45(1-2): 1-18. doi: <https://doi.org/10.1080/09613218.2017.1256136>
- Lomax, H., T. H. Pulliam, and D. W. Zingg. 2013. *Fundamentals of Computational Fluid Dynamics*. Springer Berlin Heidelberg.
- Mentor Graphics Corporation. 2018. *FloVENT® Background Theory Reference Guide v.12.2*. www.mentor.com
- Mora-Pérez, M., I. Guillen-Guillamón, P. A. López-Jiménez. 2017. "A CFD study for evaluating the effects of natural ventilation on indoor comfort conditions." *AIMS Environmental Science* 4(2): 289-309. doi: <https://doi.org/10.3934/ENVIRONSCI.2017.2.289>
- Rodrigues, L. T., M. Gillott, and D. Tetlow. 2013. "Summer overheating potential in a low-energy steel frame house in future climate scenarios." *Sustainable Cities and Society* 7: 1-15. doi: <https://doi.org/10.1016/J.SCS.2012.03.004>
- Santamouris, M. 2016. "Cooling the buildings – past, present and future." *Energy and Buildings* 128: 617-638. doi: <https://doi.org/10.1016/J.ENBUILD.2016.07.034>
- Santos, P. 2017. "Energy Efficiency of Lightweight Steel-Framed Buildings." *Energy Efficient Buildings*. doi: <https://doi.org/10.5772/66136>
- Soares, N., P. Santos, H. Gervásio, J. J. Costa, and L. Simões da Silva. 2017. "Energy efficiency and thermal performance of lightweight steel-framed (LSF) construction: A review." *Renewable and Sustainable Energy Reviews* 78, 194-209. doi: <https://doi.org/10.1016/J.RSER.2017.04.066>
- UNI. 2017. *UNI EN ISO 13786:2017 - Thermal performance of building components - Dynamic thermal characteristics - Calculation methods*.
- UNI. 2006. *UNI EN ISO 7730:2006 - Ergonomics of the thermal environment - Analytical determination and interpretation of thermal comfort using calculation of the PMV and PPD indices and local thermal comfort criteria*.
- Yang, L., and Y. Li. 2008. "Cooling load reduction by using thermal mass and night ventilation." *Energy and Buildings* 40(11): 2052-2058. doi: <https://doi.org/10.1016/J.ENBUILD.2008.05.014>